


NOTES:

- 1 REVIEW DETAILS AND REVISE AS NEEDED TO SUIT PROJECT REQUIREMENTS.
- 2 SIZE CONDENSATE BRANCH LINE NO SMALLER THAN THE TRAP INLET – MINIMUM TRAP SIZE 3/4”.
- 3 REFER TO LANL FACILITY CONSTRUCTION SPECIFICATIONS SECTIONS 15520 AND 15525.

SEQUENCE OF OPERATION

THE ROOM THERMOSTAT CYCLES THE FAN MOTOR TO MAINTAIN THE PREDETERMINED SETTING.

AUTO-OFF-ON SWITCH ALLOWS FAN OPERATION FOR VENTILATION.

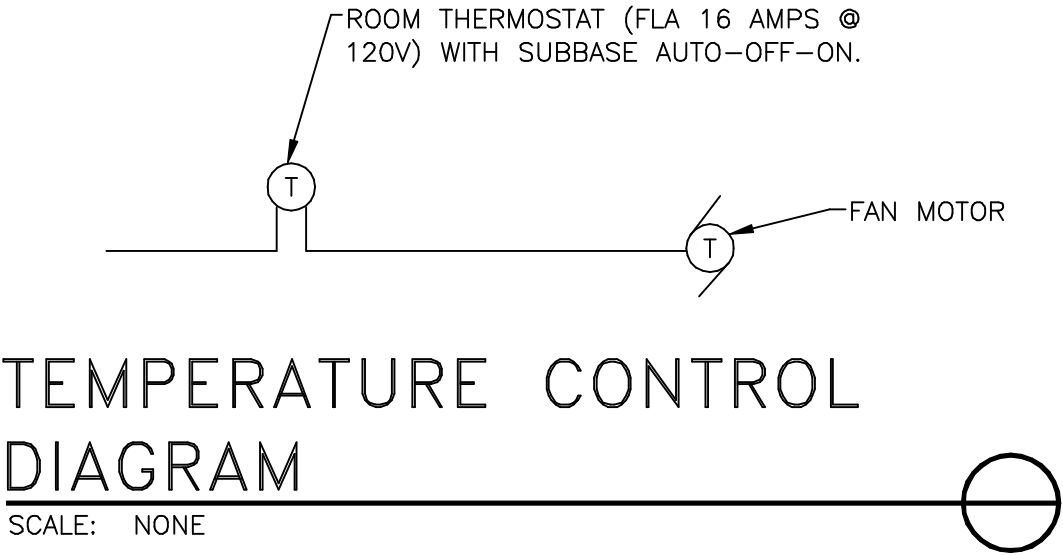

| | | | | |
|--|------|------------------------|---------------------------|--|
| | | | | |
| NO. | DATE | CLASS REV | REVISIONS | APP |
| FACILITY ENGINEERING MANUAL | | | | |
| STEAM UNIT HEATER PIPING | | | | |
| DESIGN NOTES AND CONTROLS | | | | |
| APPROVED: DISCIPLINE POC DANNY NGUYEN | | | | DATE: 6-28-99 |
| Los Alamos | | | | Los Alamos National Laboratory Los Alamos, New Mexico 87545 |
| CLASSIFICATION: U | | REVIEWER: DANNY NGUYEN | | DATE: |
| REFERENCE DOCUMENT: CHAPTER 6 | | | DRAWING NUMBER: ST6201 | |
| | | | | REV |